




C.P.R.
STANDARD
N^o 2 ENCLOSED TANK
40000 GALLONS




Approved Vice President Asst. Chief Engineer

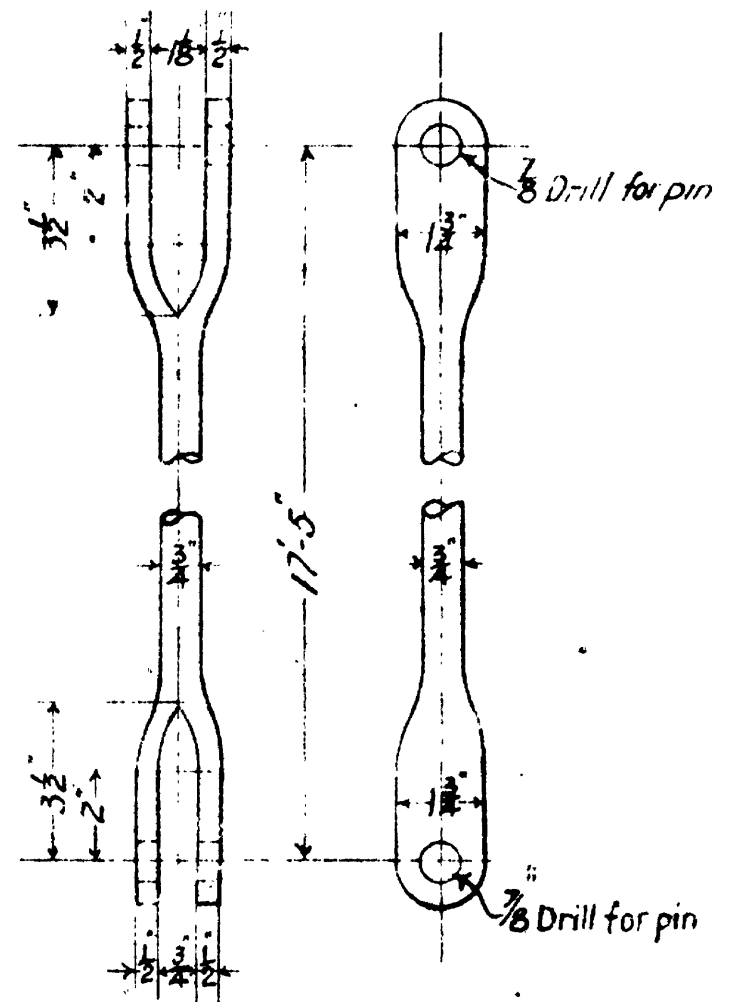


Forged Connecting Rod
Bell-crank lever to valve lever
1 Req^d

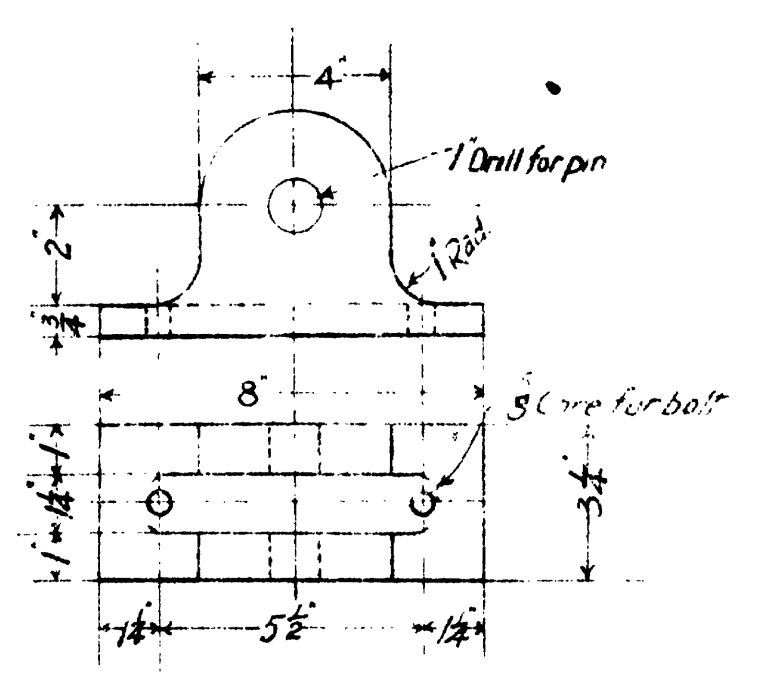


Cast Iron Bracket for Bell-crank lever
1 Req^d
Pat. N^o 7,345

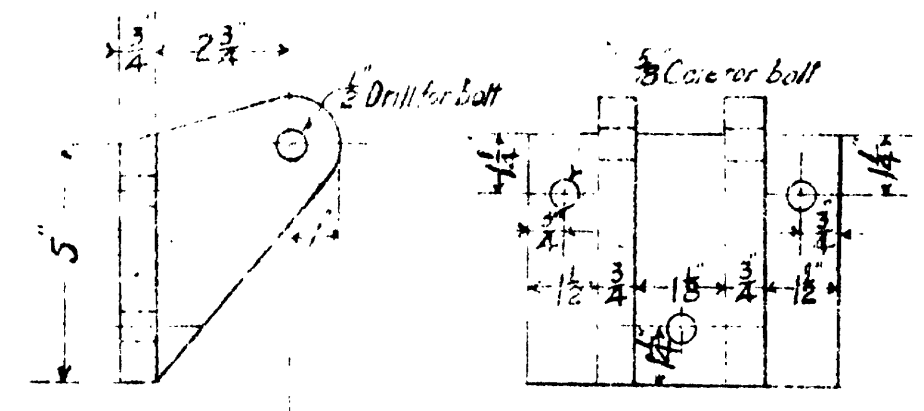


Cast Iron Bracket for 5 Sheave
1 Req^d
Pat. N^o 7,350

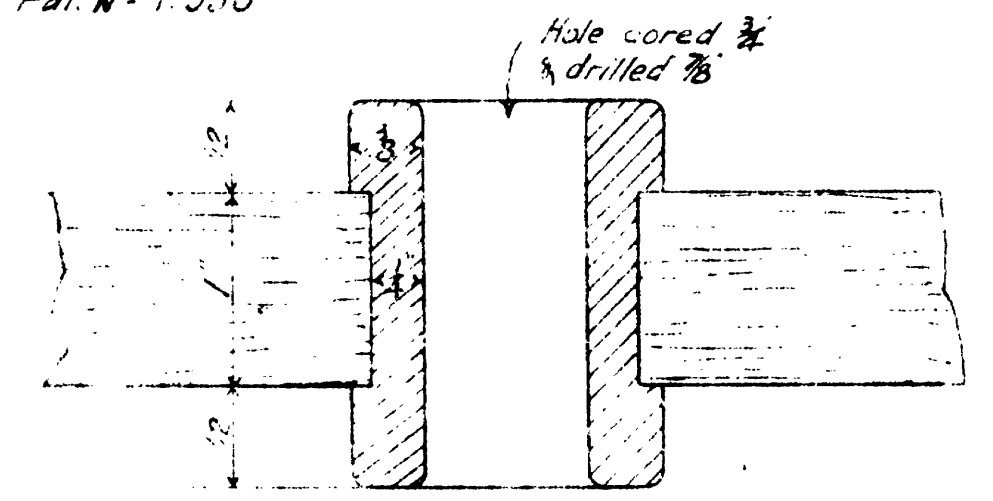


Section
C.I. Thimble for Valve Rope - Full Size

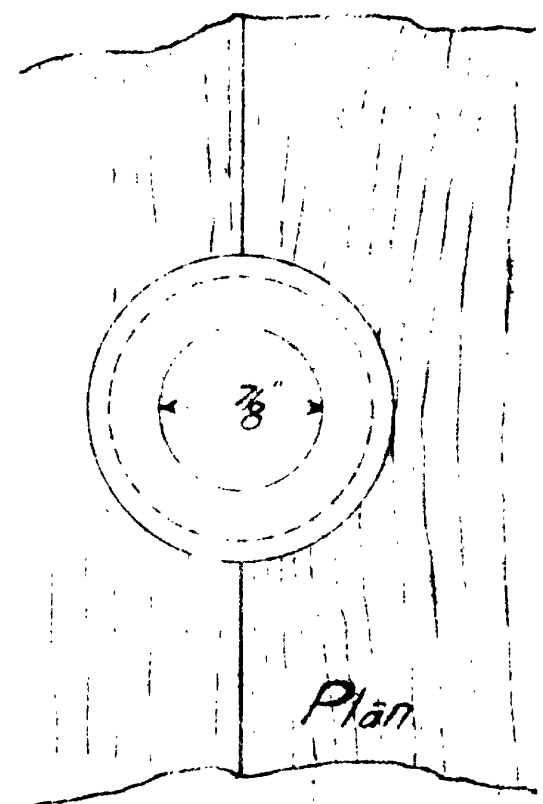


Plan

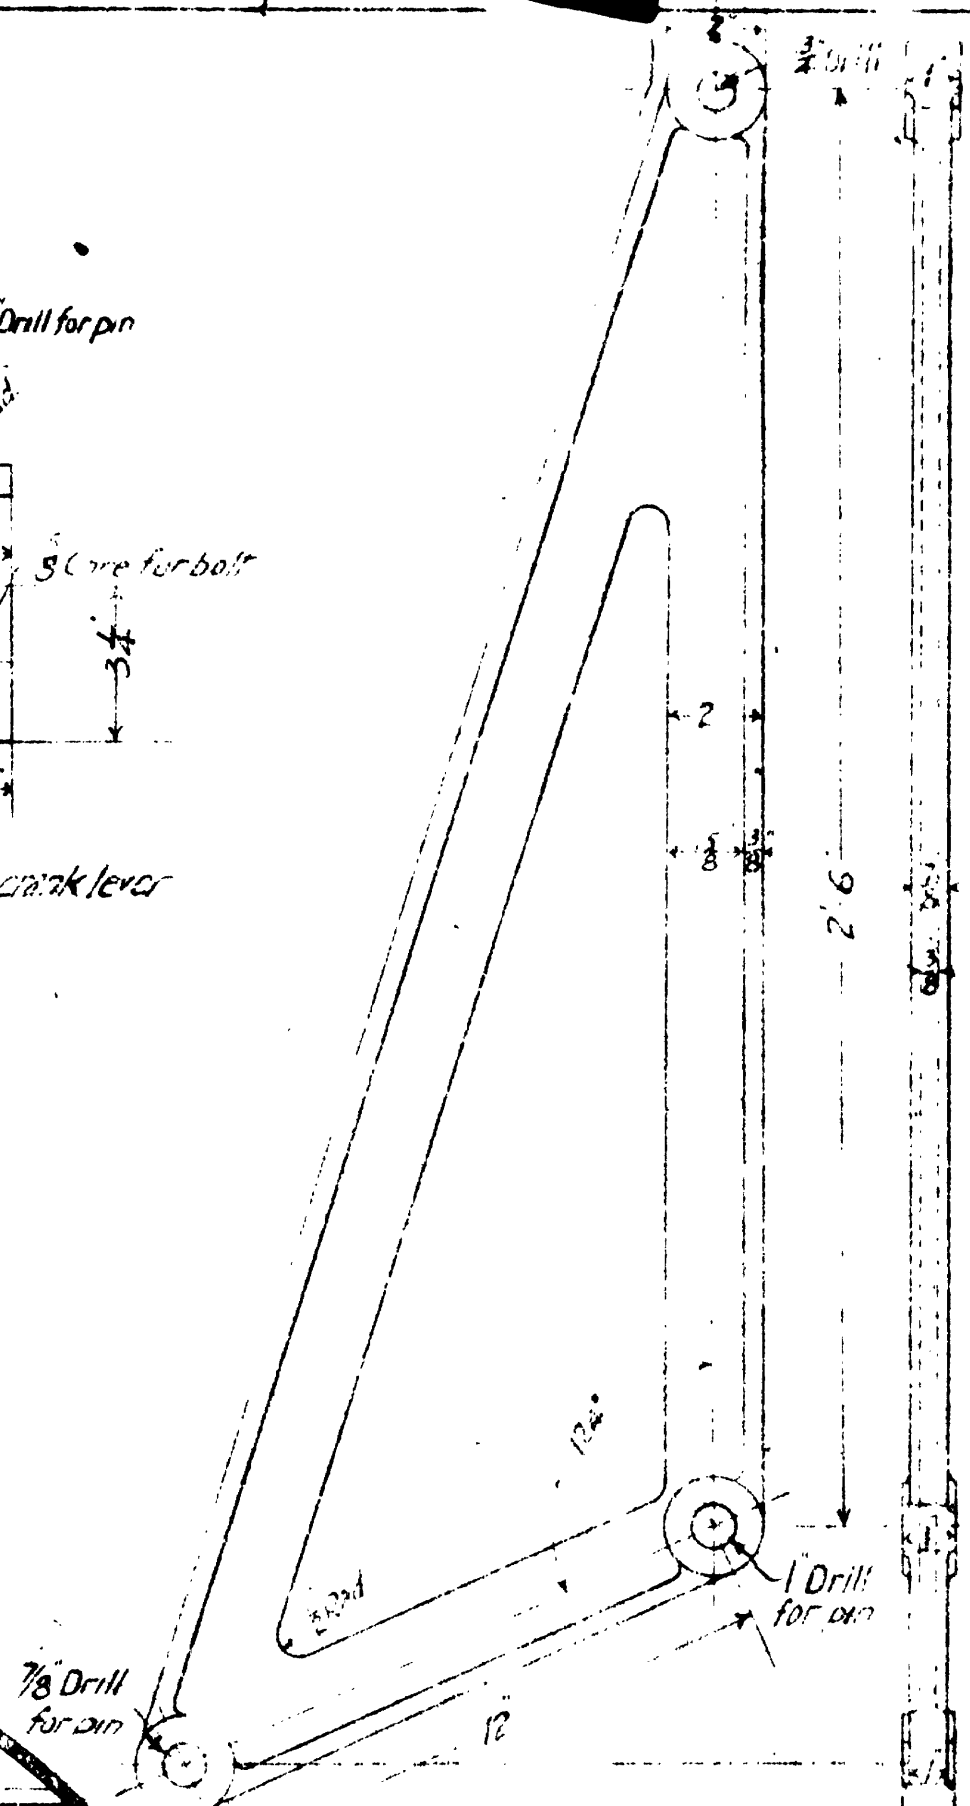


Main Cast Iron
Pat. N^o 7,349-A
1 Req^d

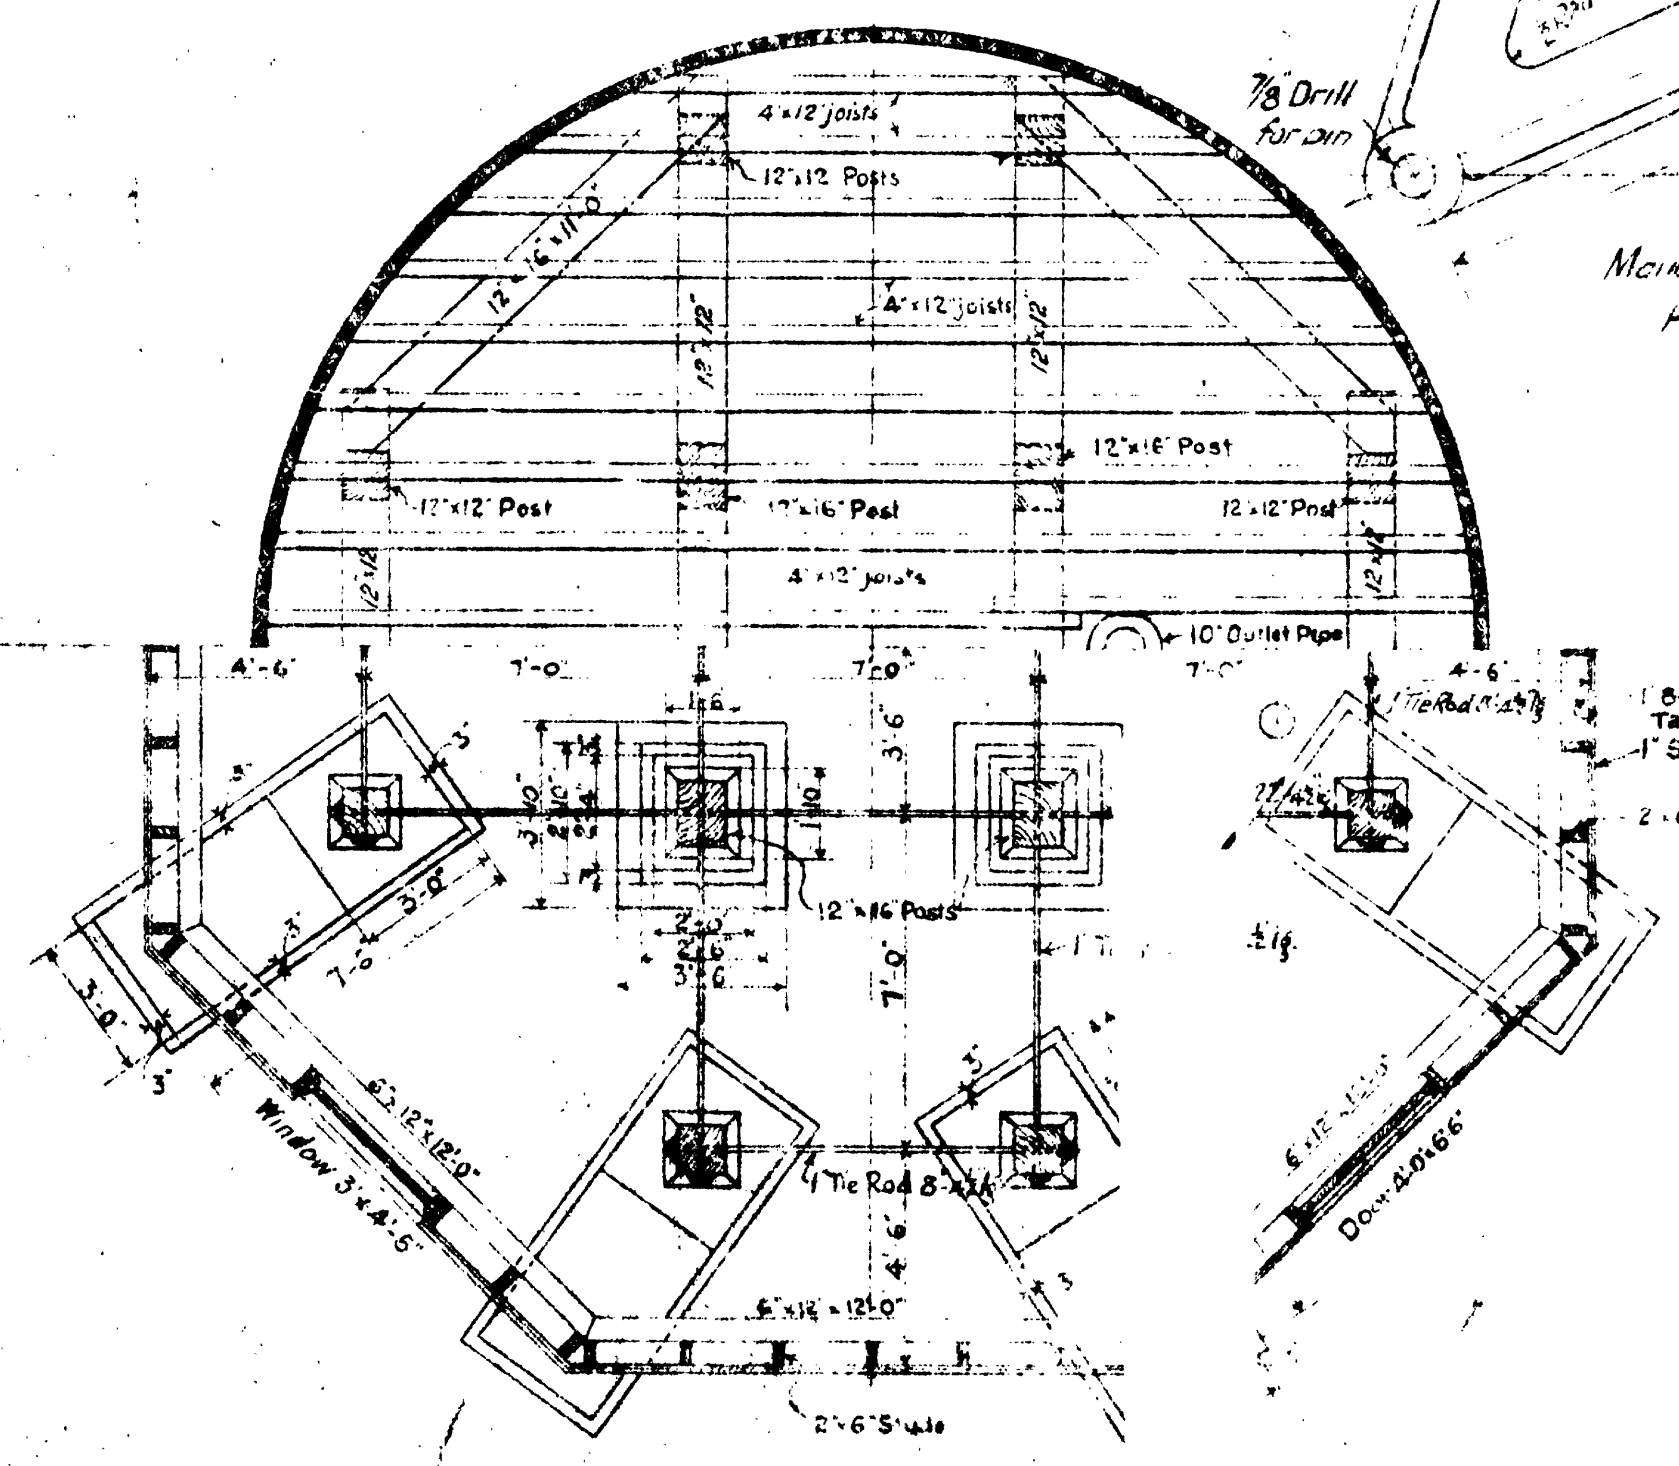

HALF-PLAN OF JOISTS UNDER TANK
HALF FOUNDATION PLAN

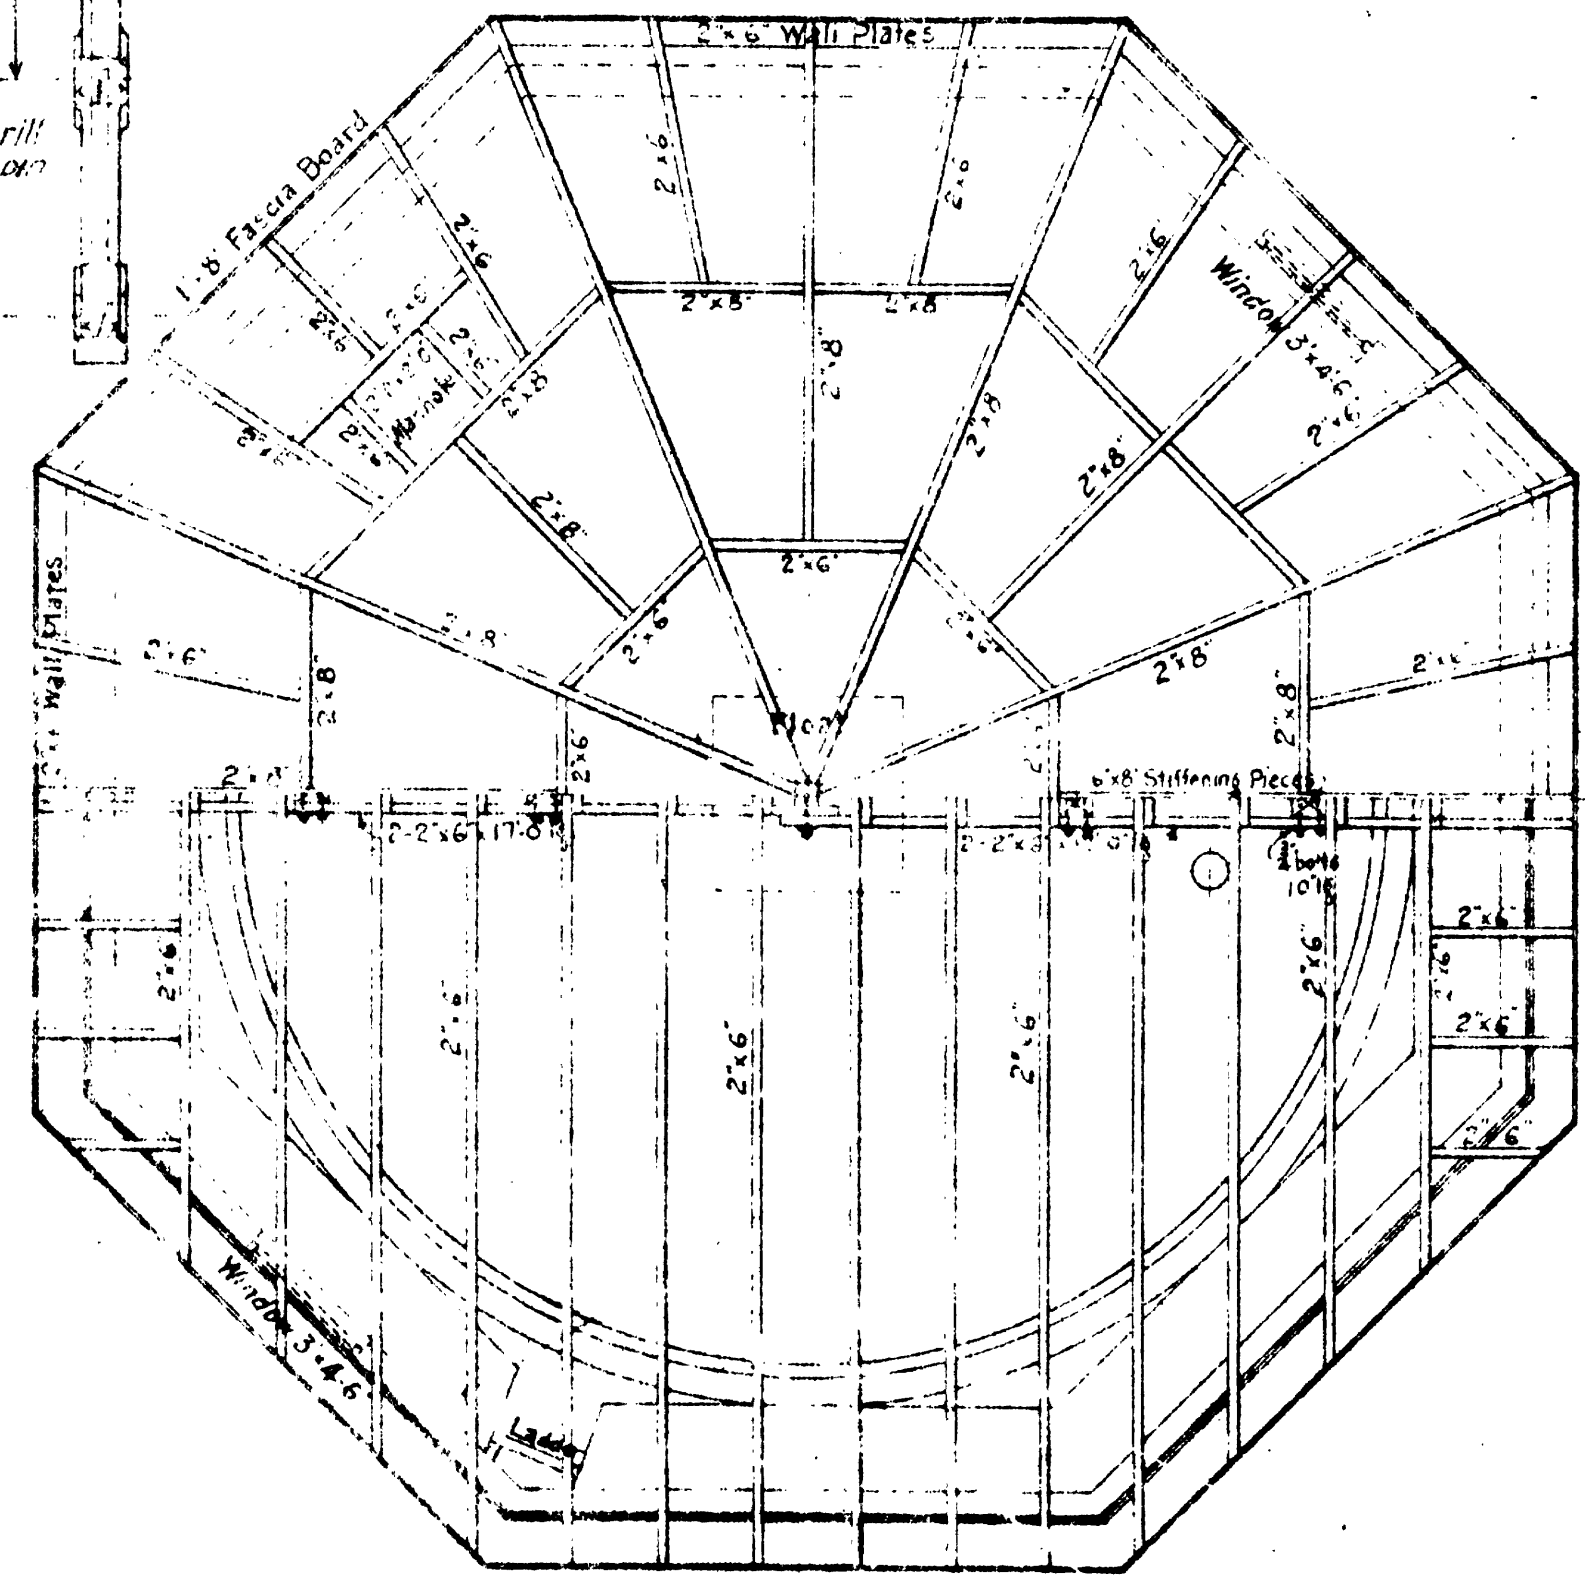

HALF-PLAN OF RAFTERS
HALF-PLAN OF CEILING JOISTS

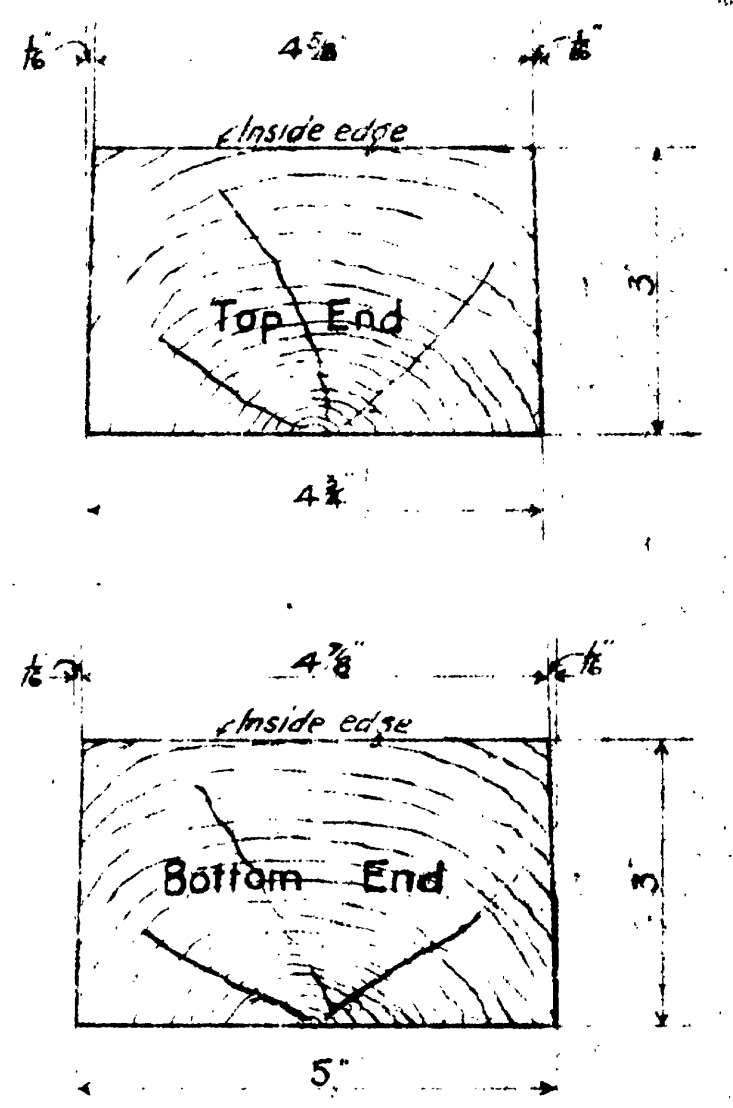

DETAIL OF STAVE
HALF FULL SIZE